

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

ORDER NO. 77-50

WASTE DISCHARGE REQUIREMENTS
FOR
RED ROOSTER CAMP
North of Blythe - Riverside County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. William Booth (hereinafter also referred to as the discharger), P. O. Box 2725, Parker Star Rt., Blythe, CA 92225, submitted a Report of Waste Discharge dated April 10, 1977.
2. The discharger is discharging during the peak season an average of 3,500 gallons-per-day of domestic sewage from a travel trailer park having 15 trailer spaces, 13 campsites, 4 restrooms, and a laundry room. The disposal system has a design flow of 4,000 gallons-per-day. The wastewater is discharged through a septic tank/seepage pit disposal system located in the S $\frac{1}{2}$ of Section 25, T3S, R23E, SBB&M. The park has approximately 700 feet of frontage on the Colorado River.
3. The discharge of this travel trailer park has been subject to waste discharge requirements adopted in Board Resolution No. 70-69. The discharger states that there has been no significant change in the discharge.
4. The Water Quality Control Plan for the East Colorado River Basin was adopted by the Board on April 10, 1975. The Basin Plan contains water quality objectives for the Colorado Hydrologic Unit.
5. The beneficial uses of the groundwaters of the Colorado Hydrologic Unit are:
 - a. Municipal supply
 - b. Industrial supply
 - c. Agricultural supply

*Superseded
11/14/84
by 84-112*

6. The Board has notified the discharger and interested agencies and persons of its intent to update waste discharge requirements for the discharge.
7. The Board in a public meeting heard and considered all comments pertaining to the discharge.
8. This travel trailer park constitutes an ongoing project in accordance with provisions of the California Environmental Quality Act (Public Resources Code Section 21000 et seq.) and the State Guidelines because the governmental approvals on or after April 5, 1973, do not involve a greater degree of responsibility or control over such activity than the governmental approvals received received prior to that date.

IT IS HEREBY ORDERED, the discharger shall comply with the following:

A. Discharge Specifications

1. Neither the treatment nor the discharge of wastewater shall create a pollution or a nuisance as defined in the California Water Code.
2. No wastewater other than domestic sewage shall be discharged into the sewerage system described in Finding No. 2 (above).
3. Sewage effluent discharged subsurface shall be retained underground with no materials of sewage origin evident on the ground surface.
4. No part of the waste discharge facilities shall be maintained closer than five (5) feet vertically from the high ground water level elevation.
5. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
6. Septic Tank cleanings shall be discharged only by a duly authorized service.

7. There shall be no discharge of any water softener brines at this location except to impervious containers from which there is no seepage or overflow, and said brines shall be periodically discharged at a disposal site approved by the Regional Board to receive these wastes.
8. There shall be no discharge of wastewater within 200 feet laterally from the regulated high-water line of the Colorado River or within 200 feet of any domestic water well.

B. Provisions


1. Prior to any modifications in this facility which could result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report thereon to the Board.
2. Upon request from this Board's Executive Officer, the discharger shall furnish technical and/or monitoring reports on the treatment and discharge of wastes.
3. In the event of any change in operation, or in control or ownership of land and/or waste disposal facilities owned or controlled by the discharger, the discharger shall:
 - a. Notify this Board of such change; and
 - b. Notify the succeeding owner or operator by letter of the existence of this Order, a copy of which shall be filed with this Board.
4. This Order supersedes Board Resolution No. 70-69.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on July 13, 1977.



Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD-7

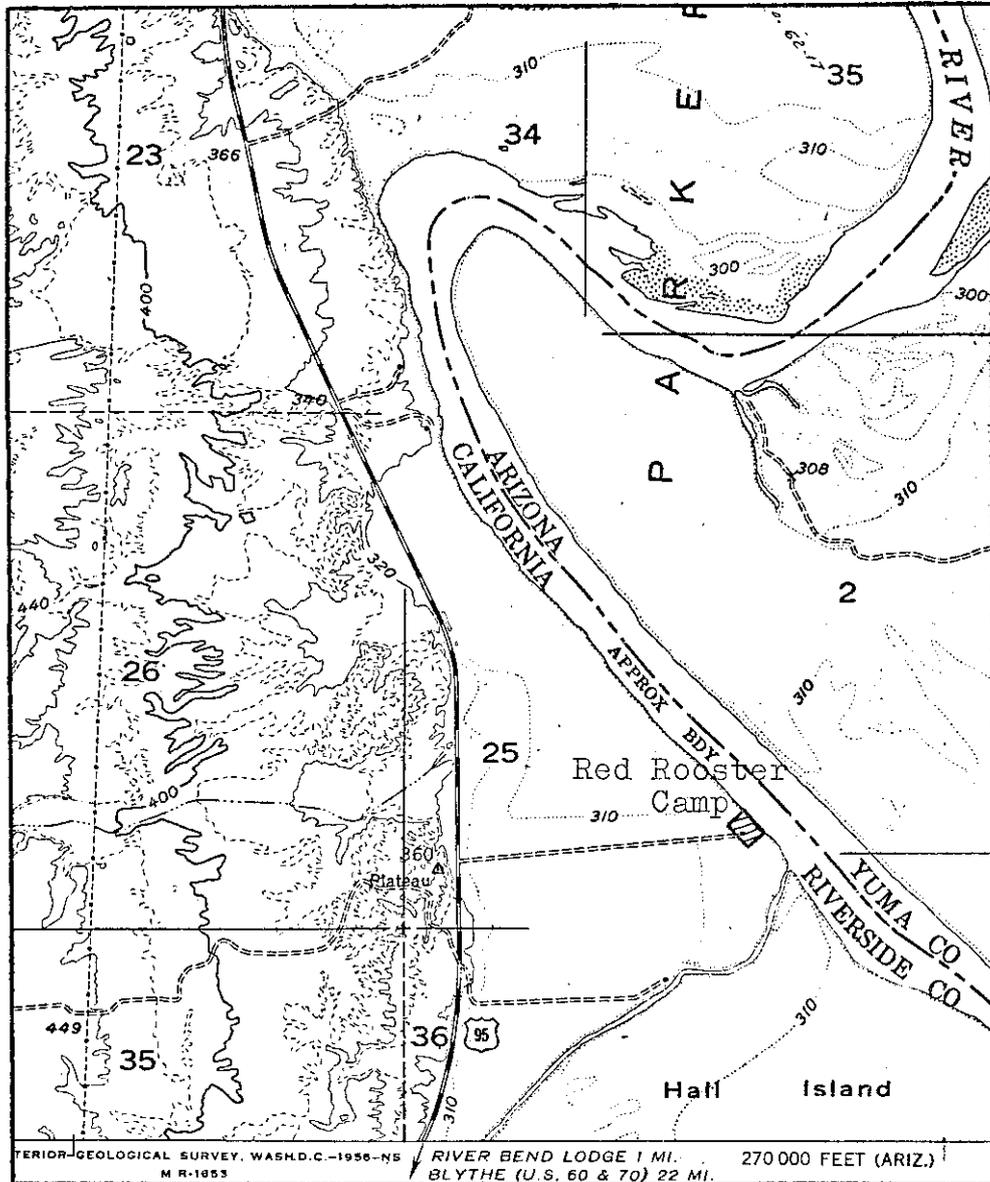

SITE MAP

RED ROOSTER CAMP
 North of Blythe - Riverside County
 S½ of Section 25, T3S, R23E, SBB&M
 Big Maria Mts. NE 7.5 min. Topographic Map

Order No. 77-50